
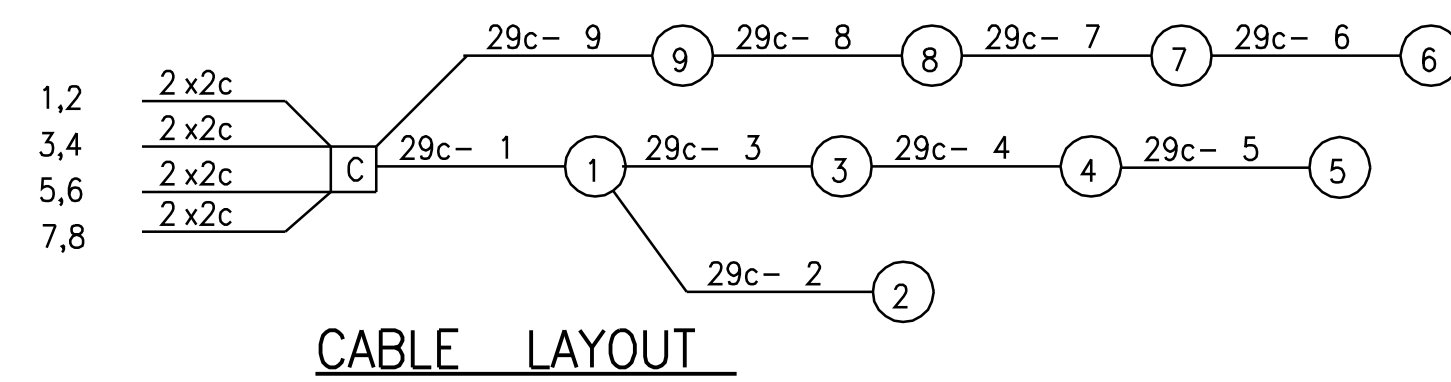
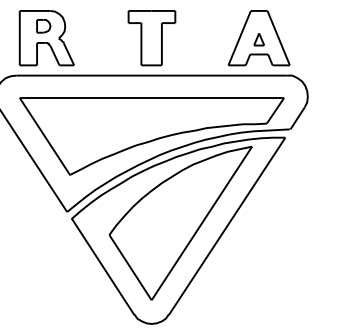


**NOTES**

1. CABLE COVER: IN FOOTWAYS 0.45 ABOVE ELECTRIC BRICKS.
2. ALL PIPES IN FOOTWAYS ARE 1x80 HD PVC UNLESS OTHERWISE STATED.

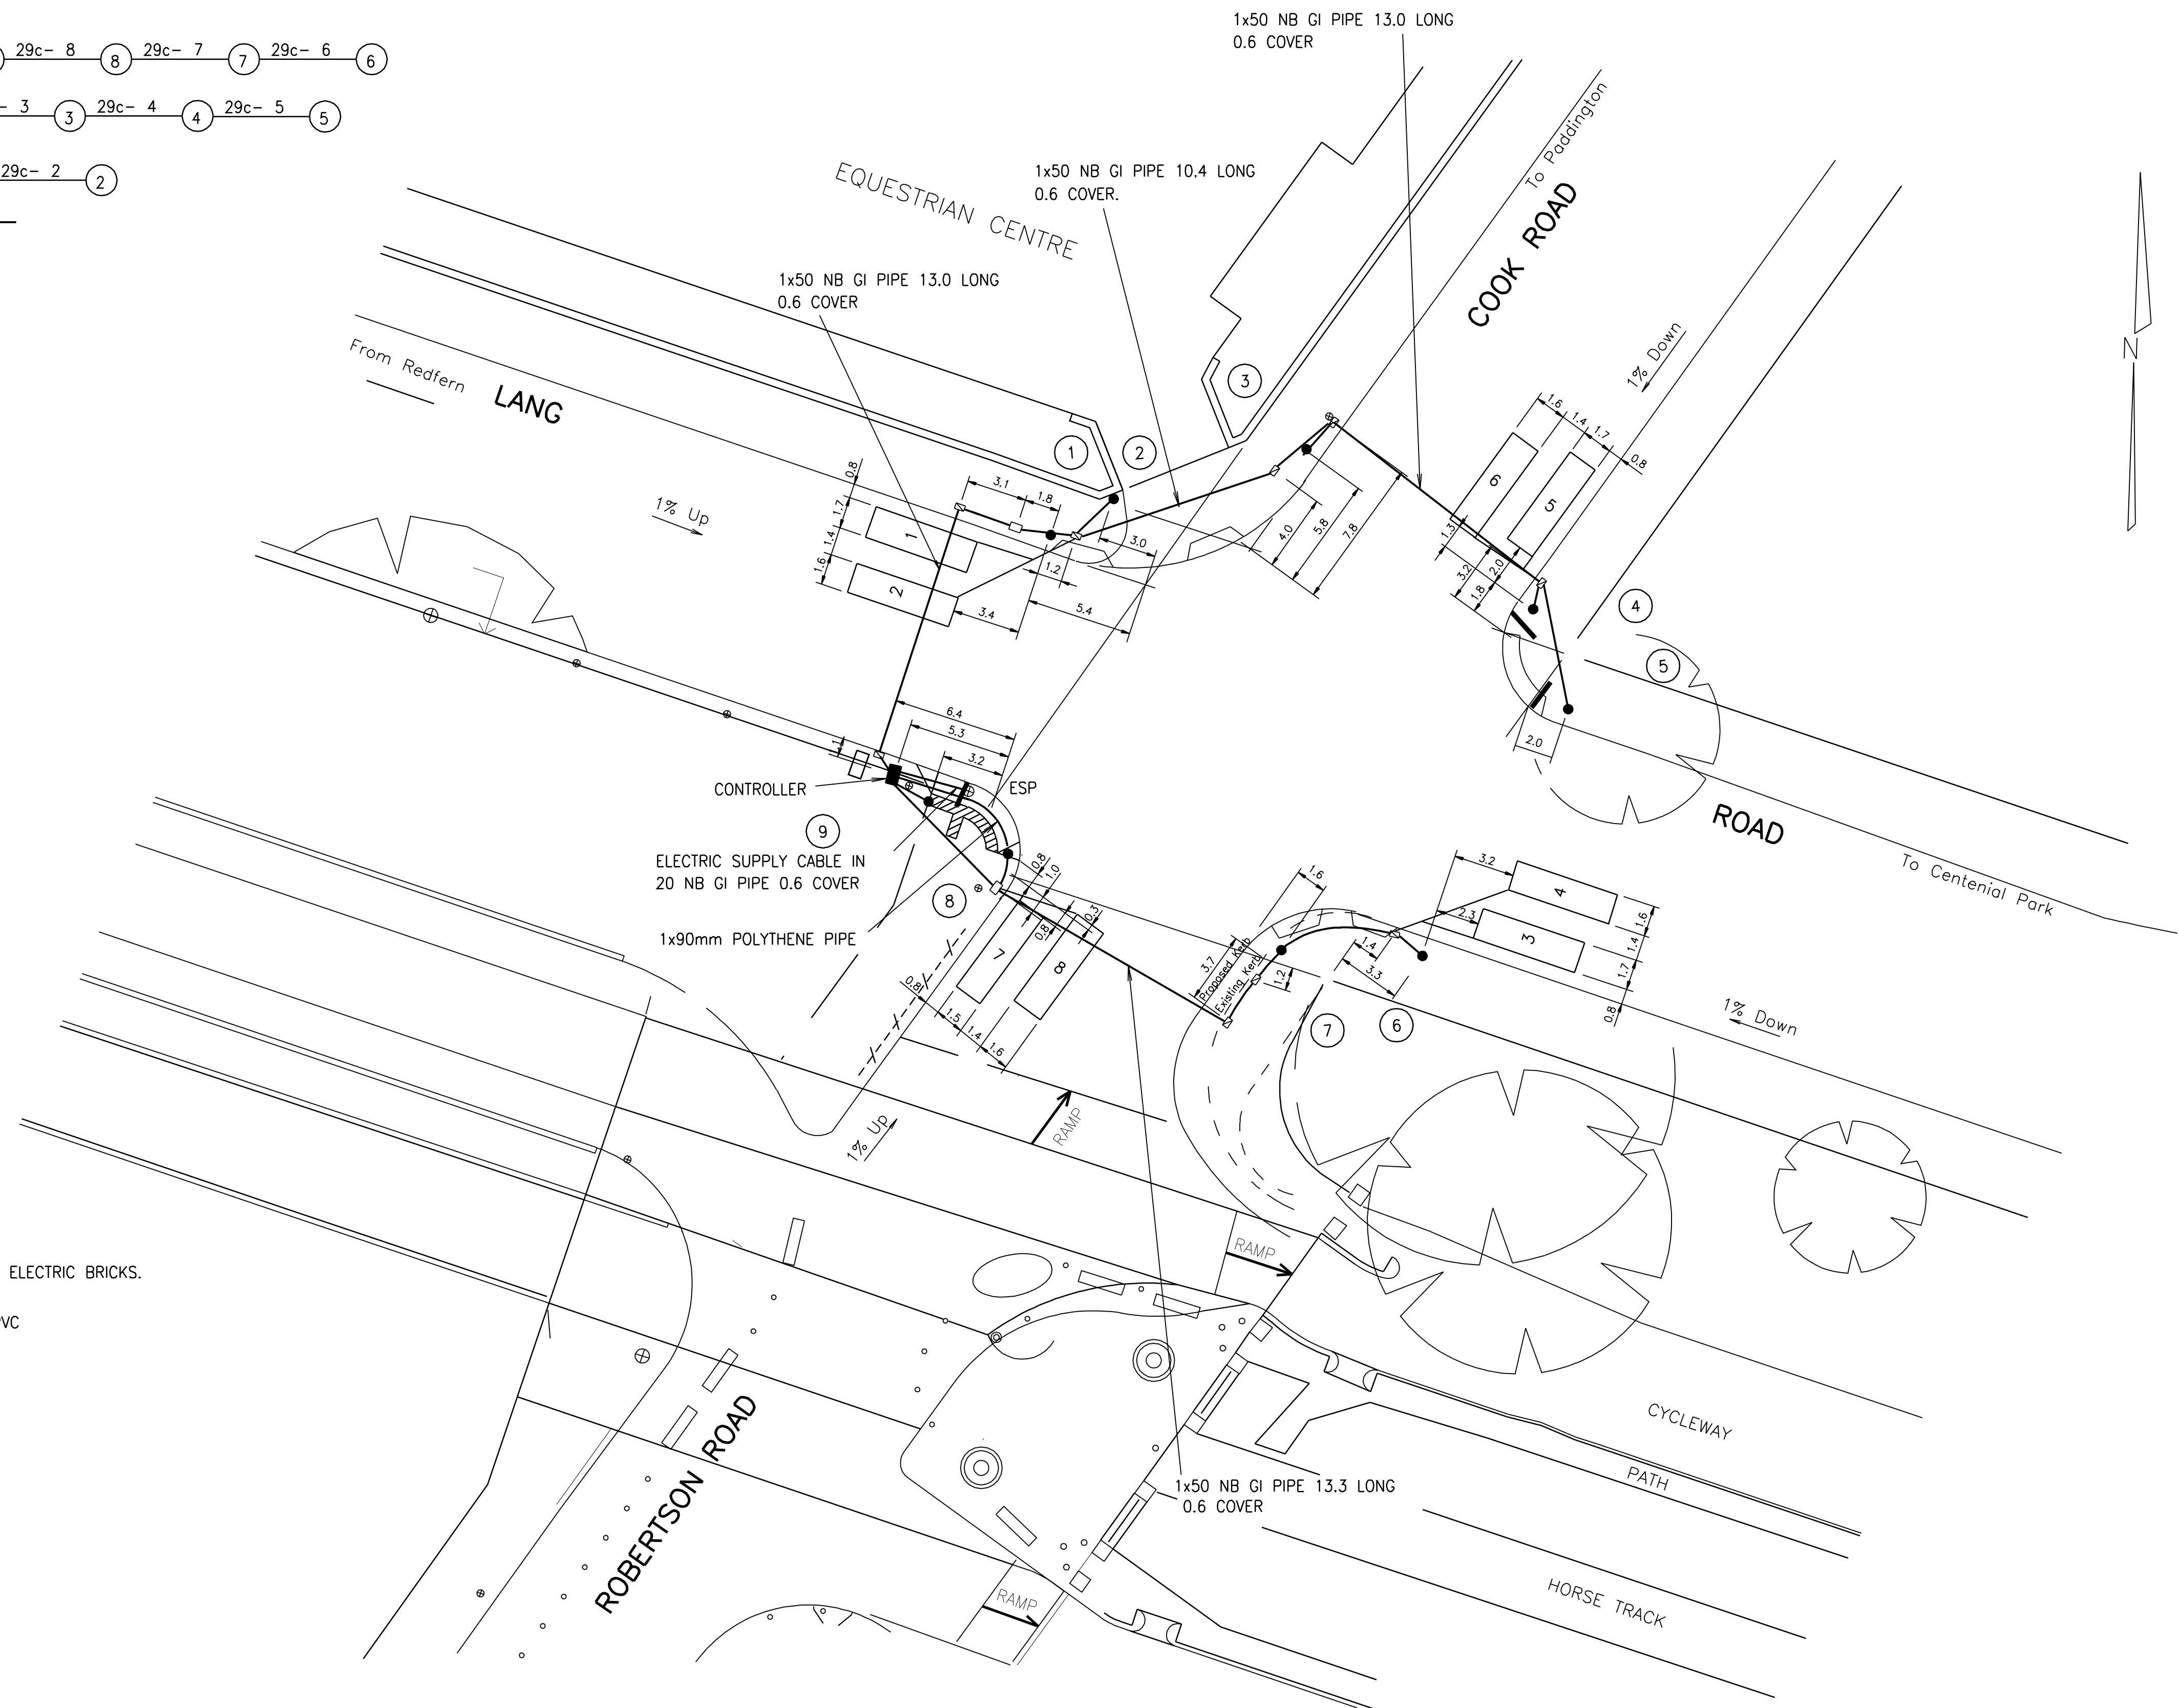

A ORIGINAL ISSUE

PUBLIC UTILITY LEGEND		REFERENCE PLANS		U.B.D. Ref.	
HYDRANT	□	SYMBOLS/ABBS.	VD003-6	I.S.G.	E:
STOP VALVE	▲	STD. POSIT.	VD001-5	CO-ORDS	N:
GAS VALVE	≡	DET. SCHED. EXP.	VD018-10	DESIGNED	LAWSON/MEYER
SEWER MANHOLE	⊗	PRES. DETECT.	VC005-17	CHECKED	
TELECOM PIT	■	SSG DIS. SEQ.	VD018-8	SITE CHECKED	
ELECT. LIGHT POLE	○	DESIGN LAYOUT	SHEET 11	RECOMMENDED	
POWER POLE	○	CABLE CHART	SHEET 13		
STAY POLE	⊙				
TELEPHONE BOX	⊞	SURVEYOR :			
TELECOM PILLAR	●	DATE :			

APPROVED

R.C. Bird
R.C. BIRD
ELECTRICAL DESIGN MANAGER
17/02/02
DATE

Roads and Traffic Authority, N.S.W.

CITY OF SYDNEY
LANG ROAD, COOK ROAD
& ROBERTSON ROAD
MOORE PARK

CABLE INSTALLATION

TCS No 403

DESIGN OFFICE PARRAMATA-SEDNEY TECHNICAL SERVICES

CAD FILE : VV0403_12A_INS.DGN

SCALE 5 0 (1:200) 5 10

FILE 412.TS.401 SUPERSEDES SHEET/ISSUE 9/C

REGN. 7000.412.W.0403

ISSUE A

SHEET 12