You are working near Transmission Cables. You must contact Ausgrid on (02) 4951 9200 at least two weeks before work commences. See Ausgrid Network Standard NS156.

This plot is for reference only. Please refer to the individual plans for detailed information

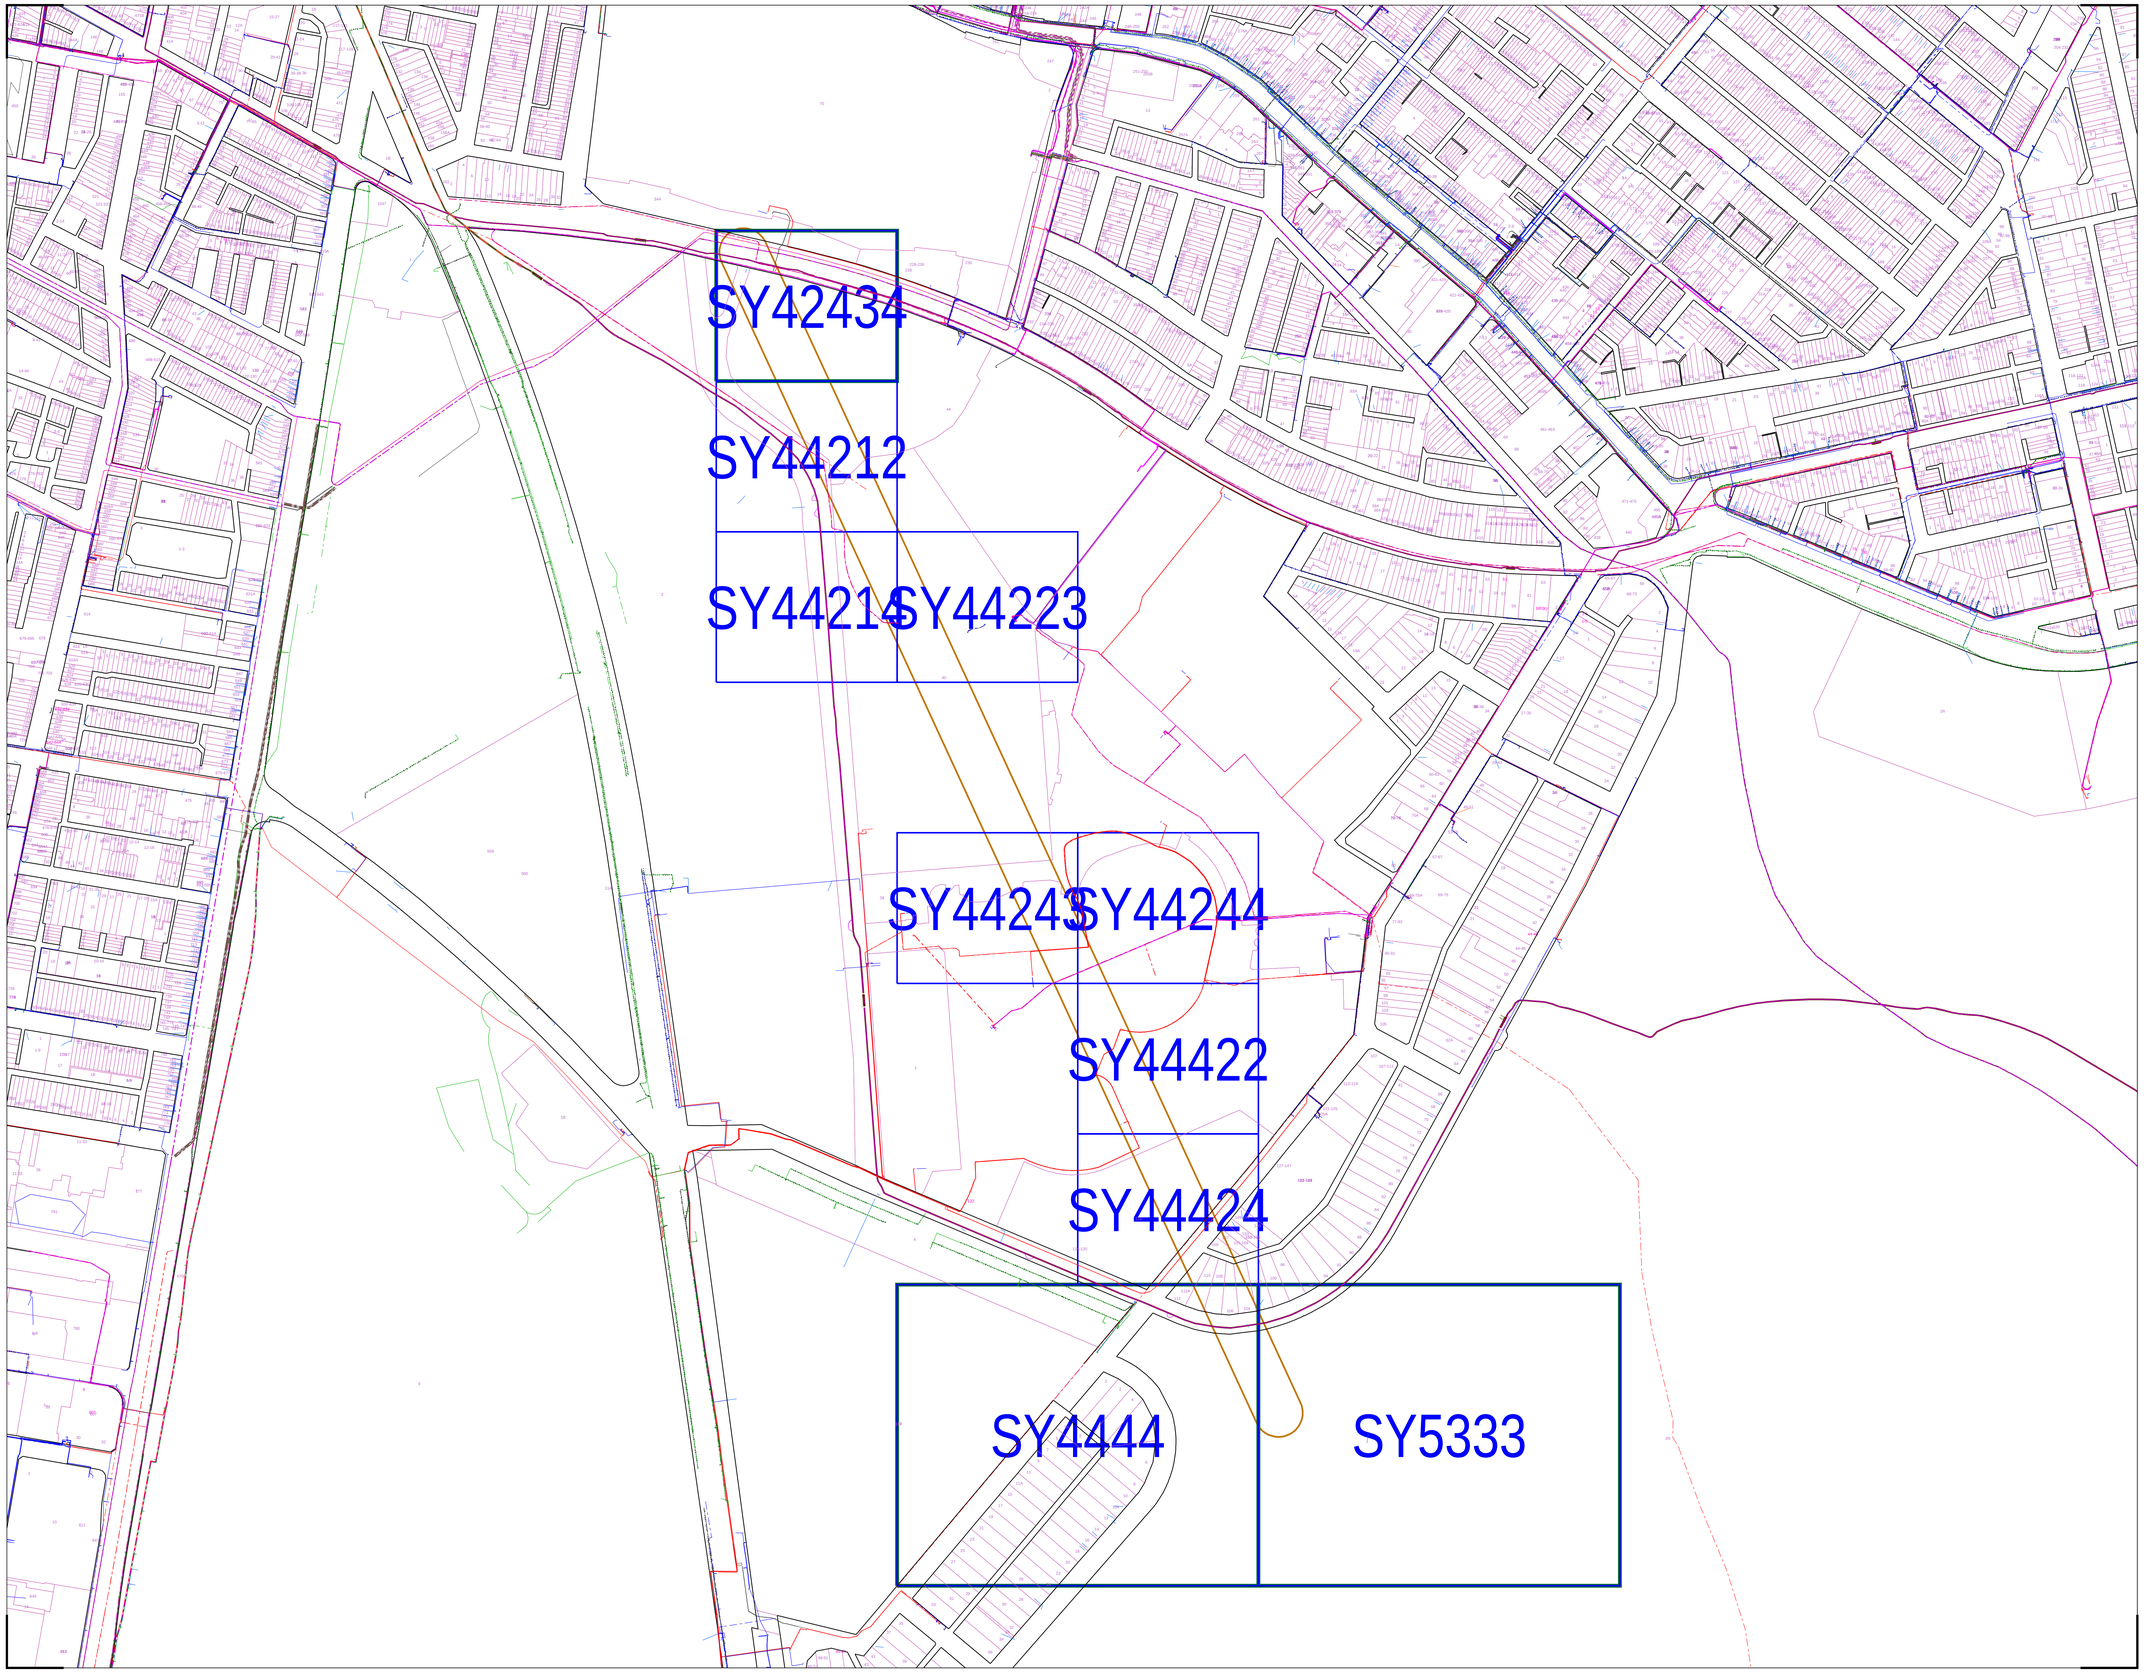

WARNING

Ausgrid's plans show the position of assets at the time of installation and may not account for subsequent changes to road alignments, fences or buildings. The plans show no more than the presence or absence of Ausgrid assets in the Street.
Persons working near electricity networks must exercise care and will be held responsible for the safety of their work.
You must excavate by hand or use vacuum excavation to establish the location of Ausgrid underground cables and associated assets.
Underground: Working near a cable may result in electric shock even if no contact is made. Any work in the vicinity of any cable should only be performed using safe work methods developed in accordance with the recommendations included in Safework NSW Code of Practice for Excavation and WorkCover Guide for Work Near Underground Assets
as well as recommendations of Ausgrid's Network Standard NS156.
Overhead: Do not excavate near poles or towers until the stability of the foundation has been assessed by Ausgrid. Cables or earth conductors may be present close to substations, poles or towers.
Workers must maintain safe approach distances and follow applicable WorkCover Guidelines & Codes.
NOTES: 1. You must keep Ausgrid plans on site during excavation works. If the people actually performing the excavation works do not know how to read and interpret Ausgrid's plans, then the work must be directed by a person who knows how to read and interpret the plans. 2. This information includes data from the NSW Digital Cadastral Database by Land and Property Information (c) 2016, used under Creative Commons licence version 4.0.

N

COVERGMLA0

Cover Sheet - 98549661

INFORMATION ON THIS PLAN ONLY VALID FOR 30 DAYS FROM ISSUE DATE

Page 1 of 1

10 Jun 2020

1:2251

0 — 135 metres

SY423	SY424	SY513
SY441		SY531
SY443		SY533

ISSG GRID

Ausgrid

A0 MOCS_std_plot

E_SERVICES_COVERGMLA0_1.DWG